



# Winding Ohmmeter & Tap Changer Analyzer RMO60TD

- Lightweight – 13 kg
- Test current 5 mA – 60 A DC
- Measuring range 0,1  $\mu\Omega$  - 2 k $\Omega$
- Two voltage sense channels
- Extremely quick measurement
- Extremely quick automatic demagnetization
- Automatic discharge circuit
- Built-in Tap Changer Control Unit



## High DC current resistance meter for transformers & tap changer analyzer

### Description

The Winding Ohmmeter & Tap Changer Analyzer RMO60TD is designed for resistance measurement of inductive test objects. RMO60TD generates true DC ripple free current. Both injection of current and discharge of energy from the inductance are automatically regulated.

RMO60TD injects current with a voltage as high as 60 V. This ensures that the duration of test is as short as possible, and that the desired test current is reached faster. Two independent channels enable testing of two series windings, or primary and secondary windings. There is enough memory within RMO60TD instrument to store 500 measurements. All measurements are time and date stamped.

The set is equipped with thermal and overcurrent protection. The RMO60TD has very high ability to cancel electrostatic and electromagnetic interference in HV electric fields. It is achieved by very efficient filtration. The filtration is made utilizing proprietary hardware and software.

### On Load Tap Changers

The RMO60TD can be used to measure winding resistance of individual taps of a power transformer's tap changer. It can also check whether the on-load tap changer (OLTC) switches without an interruption. The moment a tap position is changed from one tap to another, the device detects a sudden, very short drop of the current. A properly working tap changer differs from a malfunctioning one. This is obvious from an interruption during the change, by the magnitude of the current ripple and also by the transition time. Malfunctioning behaviour of Tap Changer will result in much higher current ripple value and by changed transition time than a properly functioning Tap Changer. The Tap Changer Control Unit allows the operator to control the Tap Changer operation box from the RMO60TD position.

## **Transformer Demagnetizer**

The RMO60TD is intended for automatic demagnetization of power transformers and any magnetic circuit, by injecting current in steps, starting from maximum specified current down to minimum current alternately in opposite directions (positive and negative). It starts process of demagnetization from last specified test current. It also measures the time to reach predefined current magnitude for each step.

The demagnetizer is designed to eliminate any remanent magnetism stored in the magnetic core of transformers by charging and discharging DC current at diminishing magnitude, but alternating its polarity. This way the unit provides alternating current at very low frequency which slowly brings the remanent flux to zero, at programmable steps.

## **DV-Win**

Using DV-Win software, tests could be performed from a PC, and results can be obtained directly at a PC. The DV-Win software allows results to be arranged in an Excel spreadsheet, which can be shown later as a diagram and printed for a report, or ASCII format. This software can control the RMO-T instrument, allowing a condition assessment of OLTC (tap changer) analyzing the graph which represents dynamic resistance during the tap change. The DV-Win measures OLTC transition time. Using DV-Win and RMO60TD it is possible to perform heat run test on distribution and power transformers.

## **Typical application**

Typical application of RMO60TD is measuring the resistance of:

- ✓ Power transformers
- ✓ On-Load Tap Changers
- ✓ Generators and electrical motors
- ✓ High-current busbar joints
- ✓ Cable splices

## **Standard accessories**

- ✓ DV-Win PC software
- ✓ Built-in Tap Changer Control Unit
- ✓ Tap Changer Control cable set 5 m
- ✓ Mains power cable
- ✓ Ground (PE) cable


## **Optional accessories**


- ✓ Current cables 2 x 10 m 10 mm<sup>2</sup>
- ✓ Sense cables 2 x 2 x 10 m 2,5 mm<sup>2</sup>
- ✓ Current connection cable 1 x 5 m 10 mm<sup>2</sup>
- ✓ Built-in thermal printer
- ✓ Test shunt 150 A / 150 mV
- ✓ Current cables 2 x 15 m 10 mm<sup>2</sup>
- ✓ Sense cables 2 x 2 x 15 m 2,5 mm<sup>2</sup>
- ✓ Cable plastic case
- ✓ Cable bag

		
<p>RMO60TD</p>	<p>Shunt</p>	<p>Cable bag</p>
		
<p>Current cables with battery clamps</p>	<p>Voltage sense cables with alligator clamps</p>	<p>Current connection cable</p>

### Connecting a Test Object to RMO60TD


The RMO60TD should be turned off, connection between RMO60TD and the test object is such that the measuring cables from the "Voltage Sense" sockets are attached as close as possible to the measured resistance, while they are connected between the current feeding cables. That way, resistance of cables and clamps is almost completely excluded from the resistance measured. The figure to the right shows simultaneous testing of both windings (high and low) on a single-phase transformer. In such a way, it is possible to speed up the measurement when two channels are used to test both windings of the transformer.

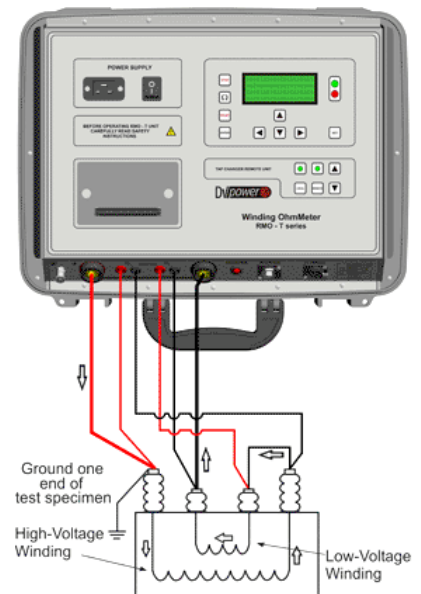

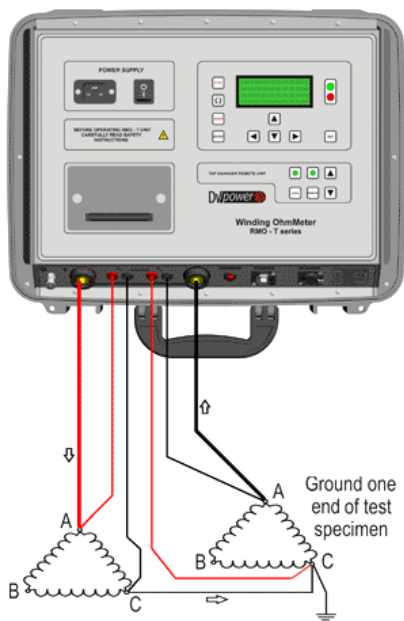

Testing of a Delta-delta winding resistance is usually a very time consuming procedure. This is because the two windings represent two closed loop inductors. When energy is brought into the inductors, this energy (in the form of D.C. current) continually circulates within each winding. To test this configuration quickly, both high and low sides should be connected in series with the current source of a Transformer Ohmmeter. By having these two windings in opposing polarity, the internal circulating currents settle very quickly to obtain a balance, and discharge with the same speed. Even if only one side of the transformer needs to be tested, connecting both high and low

Using RMO60TD's Tap Changer menu, the power transformer winding resistance of individual tap positions can be measured. Also, you can check whether the on-load tap changer switches without an interruption. The RMO60TD current output injects a constant current into a power transformer. This current and voltage value is measured, and the winding resistance is calculated.

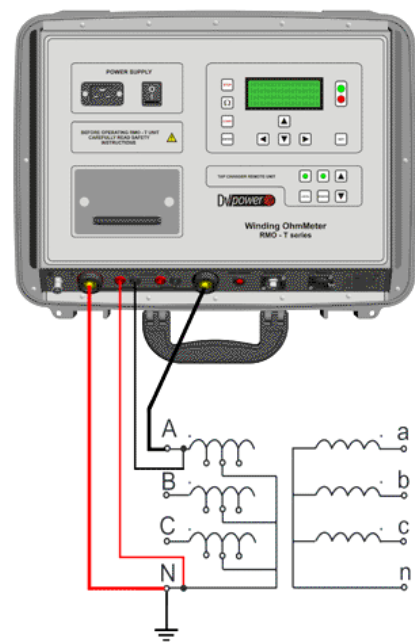

## Technical data

### 1 – Mains Power Supply

- Connection according to IEC/EN60320-1; UL498, CSA 22.2
- Voltage single phase 110 – 240 V AC, + 10 % - - 15 %
- Frequency 50 / 60 Hz

### 2 – Output data

- Test current 5 mA DC – 60 A DC
- Measuring range / Resolution
  - 0,1  $\mu\Omega$  - 999,9  $\mu\Omega$  0,1  $\mu\Omega$
  - 1,000 m $\Omega$  - 9,999 m $\Omega$  1  $\mu\Omega$
  - 10,00 m $\Omega$  - 99,99 m $\Omega$  10  $\mu\Omega$
  - 100,0 m $\Omega$  - 999,9 m $\Omega$  0,1 m $\Omega$
  - 1,000  $\Omega$  - 99,99  $\Omega$  10 m $\Omega$
  - 100,0  $\Omega$  - 999,9  $\Omega$  0,1  $\Omega$
  - 1000  $\Omega$  - 2000  $\Omega$  1  $\Omega$
- Typical accuracy  $\pm$  (0,2 % rdg + 0,2 % FS)

### 3 – Environmental conditions

- Operating temperature - 10 °C - + 55 °C / 14 °F - +131 °F
- Storage and transportation - 25 °C - + 70 °C / - 13 °F - +158 °F
- Humidity 5 % - 95 % relative humidity, non condensing

### 4 – Dimensions and Weight

- Dimensions 502 mm x 190 mm x 395 mm  
19,75 in x 7,48 in x 15,53 in  
(W x H x D)
- Weight 13 kg / 28,6 lb

- 5 - Warranty three years

### 6 - Safety Standards

- European standards LVD 2006/95/EC (EN 61010-1)
- International standards IEC 61010-1  
UL 3111-1  
CAN/CSA-C22.2 No 1010.1-92

### 7 - Electromagnetic Compatibility (EMC)

- CE conformity EMC standard 2004/108/EC

\*All specifications herein are valid at ambient temperature of + 25 °C and standard accessories.

\*Specifications are subject to change without notice.



**IBEKO POWER AB**